
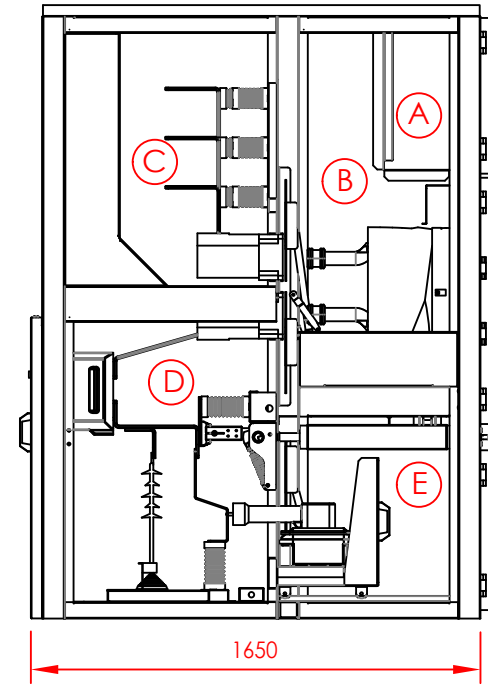
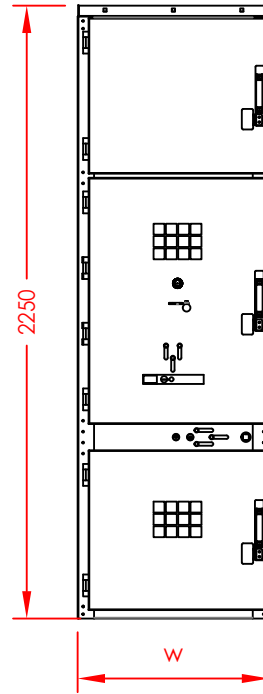


17.5kV Incoming-Outgoing Metal-Clad Switchgear with Fuse
17.5kV Sigortalı Giriş-Çıkış Hücresi

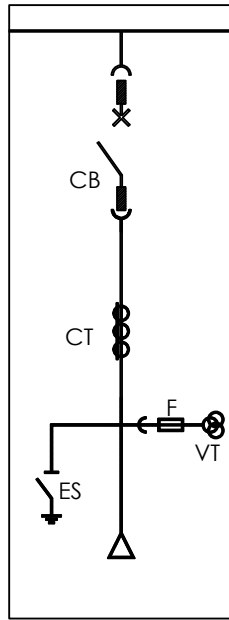

17.5kV	630-1250A	2000-2500A	2500-3150A
W	700	850	1100

(D) CABLE COMPARTMENT
KABLO BÖLMESİ

(E) FUSE COMPARTMENT
SİGORTA BÖLMESİ

(A) LOW VOLTAGE COMPARTMENT
ALÇAK GERİLİM BÖLMESİ

(B) CIRCUIT BREAKER COMPARTMENT
KESİCİ BÖLMESİ

(C) BUS-BAR COMPARTMENT
BARA BÖLMESİ