
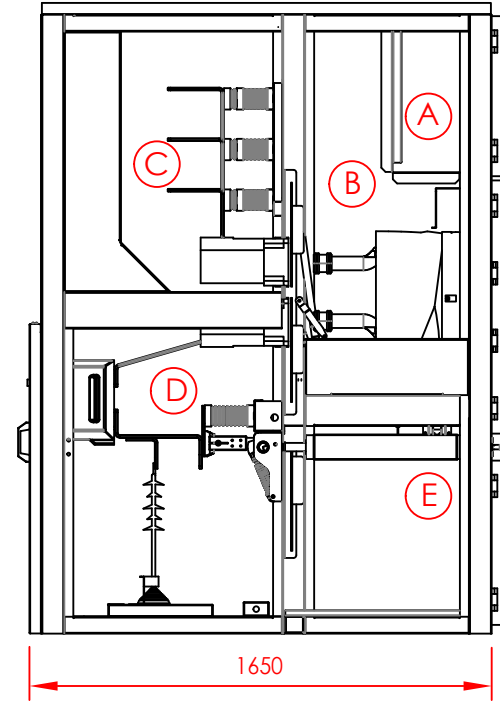
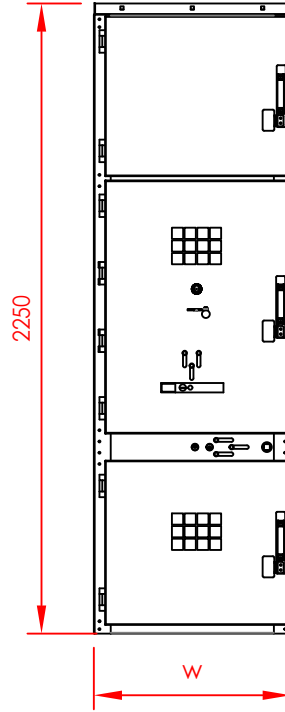


17.5kV Outgoing Metal-Clad Switchgear
17.5kV Çıkış Hücresi

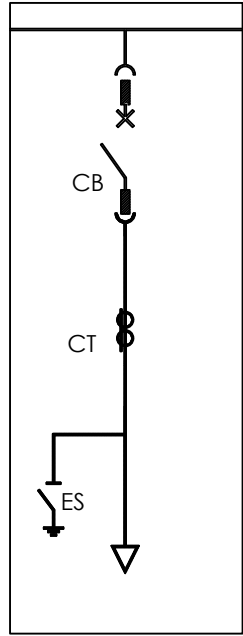

17.5kV	630-1250A	2000-2500A	2500-3150A
w	700	850	1100

(D) CABLE COMPARTMENT
KABLO BÖLMESİ

(A) LOW VOLTAGE COMPARTMENT
ALÇAK GERİLİM BÖLMESİ

(B) CIRCUIT BREAKER COMPARTMENT
KESİCİ BÖLMESİ

(C) BUS-BAR COMPARTMENT
BARA BÖLMESİ